



KSeries

Installation, Operation & Maintenance

Model: K-300, K-600, K-1000, K-3000
Acidic Condensate Neutralizer with pH Power Pellets®



For use with JJM® K-Series
K-300, K-600, K-1000, K-3000

APPLICATION

◆ Condensing boilers, hot water heaters or furnaces, and flue pipe condensate drains.

INTRODUCTION

WARNING

Please follow these installation instructions carefully in order to avoid a safety hazard, severe injury, death, and/or substantial property damage.

◆ The neutralizer should only be installed and serviced by a qualified installer/service technician. Failure to follow these instructions completely can cause a safety hazard, severe personal injury, death or substantial property damage.


◆ All JJM™ neutralizers use our proprietary pH Power Pellets®, which can only be found in JJM® products.

WARNING

Only pH Power Pellets® can be used in JJM® neutralizers. Any other media, such as limestone or marble chips, is strictly prohibited. Failure to follow these instructions completely voids the manufacturer’s limited warranty and could cause a safety hazard, severe personal injury, death or substantial property damage. For information on pH Power Pellets®, including Safety Data Sheet, visit www.jjmalkalinetech.com.

NOTE—Always consult the local authority regarding any requirements concerning flue gas condensate handling codes.

INCLUDED PARTS AND DIMENSIONS

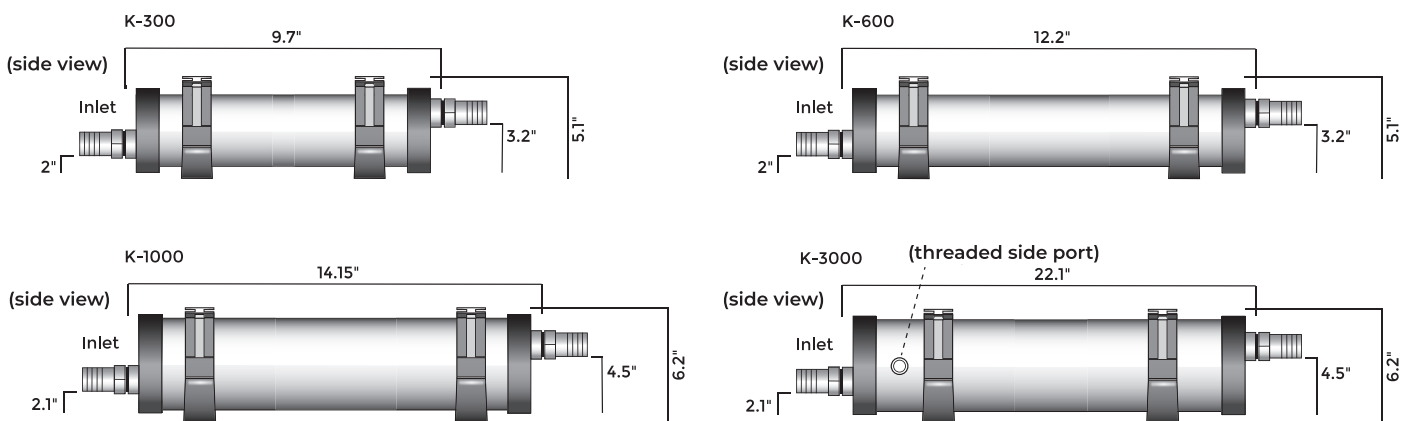

K-300/K-600/K-1000 Included Parts
(2) Screens
(2) End-caps
(2) Mounting Brackets
(2) O-rings
(2) 3/4" Socket Adapters
(2) 3/4" Barb Fittings

K-3000 Included Parts
(2) Screens
(2) End-caps
(2) Mounting Brackets
(2) O-rings
(2) 3/4" Socket Adapters
(2) 3/4" Barb Fittings
(1) Plug

For use with JJM® K-Series
K-300, K-600, K-1000, K-3000

PREPARE FOR INSTALLATION

- ◆ The neutralizer must be located at a lower elevation than the condensate drain on the appliance to ensure proper flow of condensate through the drain line. Relocate and elevate the appliance above the neutralizer, if necessary. The neutralizer can be mounted to the floor or wall.
- ◆ Prepare to route the neutralizer outlet piping to an appropriate drain. If a drain is not located within close proximity, use a condensate pump to route condensate to a suitable location.

▲WARNING

Do not exhaust flue gases through the neutralizer. Flue gas leakage or venting exhaust through the neutralizer can cause injury or death from carbon monoxide.


INSTALLATION

NOTE—Do not mount the neutralizer in a vertical position.

- ◆ Turn off electrical power and main manual gas shutoff to the appliance.
- ◆ Mount the neutralizer in a horizontal position. Affix the brackets to the floor, wall, or the side of the appliance jacket, making sure not to damage any appliance components.
- ◆ Snap the neutralizer into the brackets and remove red plugs in the neutralizer end caps.
- ◆ Connect poly tubes or PVC piping from the appliance condensate trap outlet to the neutralizer inlet using the installation kit provided. The inlet must be the lowest end cap.
- ◆ Connect the neutralizer outlet to the floor drain (or condensate pump, if applicable), making sure the drain line is level or is pitched downhill from the outlet. Access to the condensate discharge is necessary for proper maintenance to check the efficacy of the pH Power Pellets® media.
- ◆ Secure the drain piping to the floor using clamps to prevent movement.
- ◆ Use Teflon tape on all threaded plastic fittings, as appropriate, and only use appropriate corrosion-resistant pipe materials.
- ◆ Connections to the appliance and neutralizer must be installed to ensure that no condensate back flow can occur.
- ◆ Before operating the appliance, fill the neutralizer and traps with tap water to establish flow. Never operate with dry neutralizer or P-traps.
- ◆ Turn on electrical power and gas to the appliance and restore the appliance to normal operation. Verify condensate drains properly and test the pH level at the outlet of the neutralizer.

NOTE—Do not route the condensate line through any area that is exposed to freezing temperatures. If personnel traffic poses a risk, install protection to prevent movement and/or damage.

For use with JJM® K-Series
K-300, K-600, K-1000, K-3000

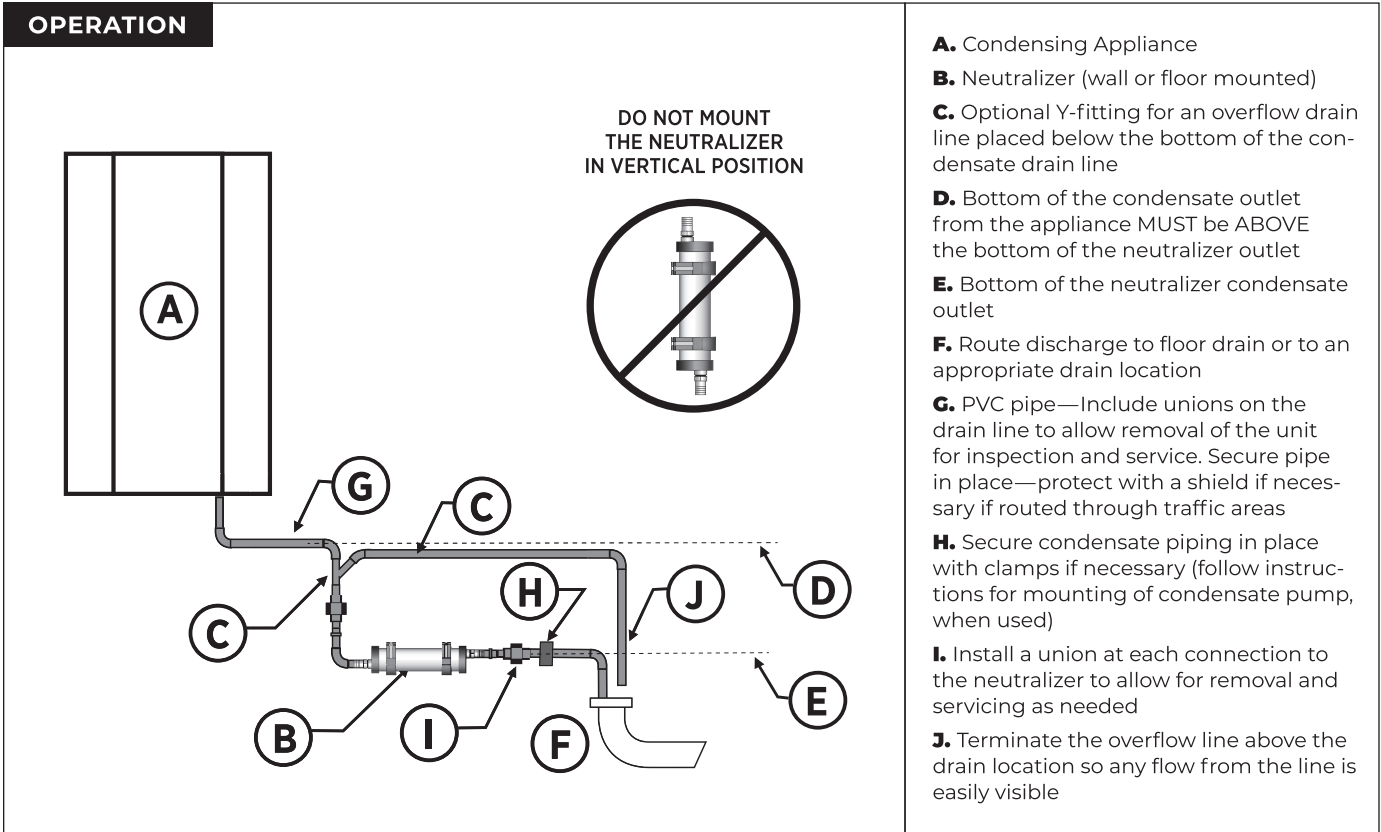

MAINTENANCE

- ◆ The neutralizer should be serviced regularly, including visual inspection for leaks or damage and replacement of the pH Power Pellets®.
- ◆ pH Power Pellets® must be replaced the sooner of (i) annually, or (ii) the pH level at the outlet of the neutralizer drops below 5.0 (or the minimum level of the local water authority).
- ◆ The pH level can be monitored by taking a sample from the outlet of the neutralizer using a suitable pH test strip or an electronic pH meter for precise measurements.
- ◆ For refills of pH Power Pellets®, contact your local JJM® distributor, a list can be found at www.jjmalkalinetech.com.

LIMITED WARRANTY

- ◆ The neutralizer is warranted against defects in materials and workmanship for one year. The warranty does not cover issues that result from misuse, improper installation, and/or failure to replace the pH Power Pellets® as instructed.